

# INTERNATIONAL STANDARD

# ISO 7547

Second edition  
2002-09-01

---

---

## **Ships and marine technology — Air-conditioning and ventilation of accommodation spaces — Design conditions and basis of calculations**

*Navires et technologie maritime — Conditionnement d'air et ventilation des  
emménagements — Conditions de conception et bases de calcul*



License to JAWA S.R.L. IAS  
ISO Store 01/01/2013/Downloaded:2007-11-12  
Single user copying and networking prohibited

Reference number  
ISO 7547:2002(E)

© ISO 2002

**PDF disclaimer**

This PDF file may contain embedded typefaces. In accordance with Adobe's licensing policy, this file may be printed or viewed but shall not be edited unless the typefaces which are embedded are licensed to and installed on the computer performing the editing. In downloading this file, parties accept therein the responsibility of not infringing Adobe's licensing policy. The ISO Central Secretariat accepts no liability in this area.

Adobe is a trademark of Adobe Systems Incorporated.

Details of the software products used to create this PDF file can be found in the General Info relative to the file; the PDF-creation parameters were optimized for printing. Every care has been taken to ensure that the file is suitable for use by ISO member bodies. In the unlikely event that a problem relating to it is found, please inform the Central Secretariat at the address given below.

© ISO 2002

All rights reserved. Unless otherwise specified, no part of this publication may be reproduced or utilized in any form or by any means, electronic or mechanical, including photocopying and microfilm, without permission in writing from either ISO at the address below or ISO's member body in the country of the requester.

ISO copyright office  
Case postale 56 • CH-1211 Geneva 20  
Tel. + 41 22 749 01 11  
Fax + 41 22 749 09 47  
E-mail [copyright@iso.ch](mailto:copyright@iso.ch)  
Web [www.iso.ch](http://www.iso.ch)

Printed in Switzerland

Licensed to /JAMES ROJAS  
ISO Store order #:862103/Downloaded:2007-11-12  
Single user licence only, copying and networking prohibited

# Contents

Page

Foreword .....	iv
<b>1 Scope .....</b>	<b>1</b>
<b>2 Normative references .....</b>	<b>1</b>
<b>3 Terms and definitions .....</b>	<b>1</b>
<b>4 Design conditions .....</b>	<b>2</b>
4.1 General .....	2
4.2 Summer temperatures and humidities .....	2
4.3 Winter temperatures .....	2
4.4 Outdoor air .....	2
4.5 Occupancy .....	3
<b>5 Calculation of heat gains and losses .....</b>	<b>3</b>
5.1 Applicability .....	3
5.2 Heat transmission .....	3
5.3 Solar heat gain .....	7
5.4 Heat gain from persons .....	7
5.5 Heat gain from lighting and other sources .....	8
<b>6 Airflow calculation .....</b>	<b>8</b>
6.1 Volume of space .....	8
6.2 Supply airflow .....	8
6.3 Temperature of supply airflow .....	9
6.4 Exhaust airflow .....	9
6.5 Air balance .....	9
<b>Annex A (informative) Guidance and good practice in the design of ventilation and air-conditioning systems in ships .....</b>	<b>10</b>
<b>Annex B (informative) Thermal conductivities of commonly used construction materials .....</b>	<b>13</b>

## Foreword

ISO (the International Organization for Standardization) is a worldwide federation of national standards bodies (ISO member bodies). The work of preparing International Standards is normally carried out through ISO technical committees. Each member body interested in a subject for which a technical committee has been established has the right to be represented on that committee. International organizations, governmental and non-governmental, in liaison with ISO, also take part in the work. ISO collaborates closely with the International Electrotechnical Commission (IEC) on all matters of electrotechnical standardization.

International Standards are drafted in accordance with the rules given in the ISO/IEC Directives, Part 3.

The main task of technical committees is to prepare International Standards. Draft International Standards adopted by the technical committees are circulated to the member bodies for voting. Publication as an International Standard requires approval by at least 75 % of the member bodies casting a vote.

Attention is drawn to the possibility that some of the elements of this International Standard may be the subject of patent rights. ISO shall not be held responsible for identifying any or all such patent rights.

ISO 7547 was prepared by Technical Committee ISO/TC 8, *Ships and marine technology*, Subcommittee SC 3, *Piping and machinery*.

This second edition cancels and replaces the first edition (ISO 7547:1985), which has been technically revised.

Annexes A and B of this International Standard are for information only.

# Ships and marine technology — Air-conditioning and ventilation of accommodation spaces — Design conditions and basis of calculations

## 1 Scope

This International Standard specifies design conditions and methods of calculation for air-conditioning and ventilation of accommodation spaces and the radio cabin on board seagoing merchant ships for all conditions except those encountered in extremely cold or hot climates (i.e. with lower or higher conditions than those stated in 4.2 and 4.3).

Annex A provides guidance and details of good practice in the design of ventilation and air-conditioning systems in ships.

Annex B gives the thermal conductivities of commonly used construction materials.

Users of this International Standard should note that, while observing the requirements of this International Standard, they should at the same time ensure compliance with statutory requirements, rules and regulations as may be applicable to the individual ship concerned.

## 2 Normative references

The following normative documents contain provisions which, through reference in this text, constitute provisions of this International Standard. For dated references, subsequent amendments to, or revisions of, any of these publications do not apply. However, parties to agreements based on this International Standard are encouraged to investigate the possibility of applying the most recent editions of the normative documents indicated below. For undated references, the latest edition of the normative document referred to applies. Members of ISO and IEC maintain registers of currently valid International Standards.

ISO 31-4:1992, *Quantities and units — Part 4: Heat*

ISO 3258:1976, *Air distribution and air diffusion — Vocabulary*

## 3 Terms and definitions

For the purposes of this International Standard, the definitions given in ISO 31-4, ISO 3258 and the following apply.

### 3.1

#### **accommodation**

space used as public rooms, cabins, offices, hospitals, cinemas, games and hobby rooms, hairdressing saloons and pantries without cooking appliances

### 3.2

#### **air-conditioning**

form of air treatment whereby temperature, humidity, ventilation and air cleanliness are all controlled within limits prescribed for the enclosure to be air-conditioned

**3.3  
ventilation**

provision of air to an enclosed space, sufficient for the needs of the occupants or the process

**3.4  
relative humidity**

ratio, in humid air, expressed as a percentage, of the water vapour actual pressure to the saturated vapour pressure at the same dry bulb temperature

**3.5  
dry bulb temperature**

temperature indicated by a dry temperature-sensing element shielded from the effects of radiation

EXAMPLE The bulb of a mercury-in-glass thermometer is an example of a dry temperature-sensing element.

## **4 Design conditions**

### **4.1 General**

The system shall be designed for the indoor air conditions specified in 4.2 and 4.3 in all accommodation spaces defined in 3.1 at the stated outdoor air conditions and the outdoor supply airflow, ventilation and air balance given in 6.2.1, 6.2.2 and 6.5 respectively.

NOTE All temperatures stated are dry bulb temperatures.

### **4.2 Summer temperatures and humidities**

Summer temperatures and humidities are as follows:

- a) Outdoor air: + 35 °C and 70 % humidity;
- b) Indoor air: + 27 °C and 50 % humidity.

NOTE In practice, the indoor air conditions obtained, especially humidity, can be different from those stated.

### **4.3 Winter temperatures**

Winter temperatures are as follows:

- a) Outdoor air: – 20 °C;
- b) Indoor air: + 22 °C.

NOTE This International Standard does not specify requirements for humidification in winter.

### **4.4 Outdoor air**

The minimum quantity of outdoor air shall be not less than 40 % of the total air supplied to the spaces concerned.

## 4.5 Occupancy

The number of persons to be allowed for in the various accommodation spaces shall be as follows, unless otherwise stated by the purchaser.

- a) Cabins:
  - the maximum number of persons for which the cabin was designed;
- b) Public rooms such as saloons, mess- or dining-rooms and recreation rooms:
  - the number of persons who can be seated or, in the case where the purchaser does not specify:
    - i) one person per 2 m<sup>2</sup> floor area for saloons;
    - ii) one person per 1,5 m<sup>2</sup> floor area for mess- or dining-rooms;
    - iii) one person per 5 m<sup>2</sup> floor area for recreation-rooms;
- c) Captain's and chief engineer's day-room:
  - four persons;
- d) Other private day-rooms:
  - three persons;
- e) Hospital:
  - the number of beds plus two;
- f) Gymnasium, games-room:
  - four persons;
- g) First-aid-room:
  - two persons;
- h) Offices:
  - two persons.

## 5 Calculation of heat gains and losses

### 5.1 Applicability

For the calculation of summer conditions, 5.2 to 5.5 inclusive shall apply.

For the calculation of winter conditions, 5.2 only shall apply.

### 5.2 Heat transmission

#### 5.2.1 Method of calculation

The following formula shall be used for calculating the transmission losses or gains, in watts, for each separate surface:

$$\Phi = \Delta T (k_v A_v) + (k_g A_g)$$

Licensed to /JAMES ROJAS  
 ISO Store order #:862103/Downloaded:2007-11-12  
 Single user licence only, copying and networking prohibited

where

$\Delta T$  is the difference in air temperature, in kelvins, (for the difference of air temperature between air-conditioned and non-air-conditioned internal spaces, see 5.2.2);

$k_v$  is the total heat transfer coefficient, in watts per square metre kelvin, for the surface  $A_v$  (see 5.2.3);

$A_v$  is the surface, in square metres, excluding side scuttles and rectangular windows (glazing + 200 mm) (see Figures 1 and 2);

$k_g$  is the total heat transfer coefficient, in watts per square metre kelvin, for the surface  $A_g$  (see 5.2.3);

$A_g$  is the area, in square metres, of side scuttles and rectangular windows (glazing + 200 mm) (see Figures 1 and 2).

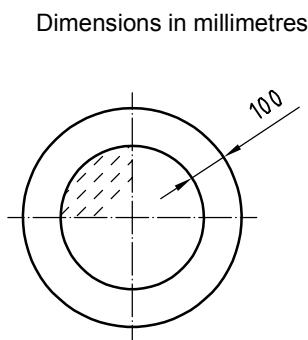


Figure 1 — Side scuttles

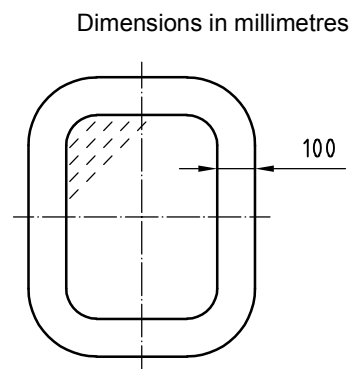


Figure 2 — Rectangular windows

5.2.2 Temperature differences between adjoining internal spaces

For differences of air temperature,  $\Delta T$ , in kelvins, between conditioned and non-air-conditioned internal spaces, see Table 1.

Table 1 — Temperature differences between adjoining internal spaces

Deck or bulkhead	$\Delta T$ , K	
	Summer	Winter
Deck against tank provided with heating	43	17
Deck with bulkhead against boiler-room	28	
Deck and bulkhead against engine-room and against non-air-conditioned gallery	18	
Deck and bulkhead against non-heated tanks, cargo spaces and equivalent	13	42
Deck and bulkhead against laundry	11	17
Deck and bulkhead against public sanitary space	6	0
Deck and bulkhead against private sanitary space		
a) with any part against exposed external surface	2	0
b) not exposed	1	0
c) with any part against engine/boiler-room	6	0
Bulkhead against alleyway	2	5
NOTE	It is understood that means of heating are provided in exposed sanitary spaces.	



### 5.2.3 Total heat transfer coefficients

The values for the total heat transfer coefficients,  $k$ , in watts per square metre kelvin, given in Table 2 assume that adequate thermal insulation is provided on all surfaces exposed to outdoor conditions or adjoining hot or cold spaces, or hot equipment or pipework.

The values given in Table 2 shall be used where appropriate, unless otherwise advised by the purchaser. For other cases, a method calculation of coefficient is given in 5.2.4.

### 5.2.4 Calculation of heat transfer coefficient

The heat transfer coefficient shall be calculated as follows:

$$\frac{1}{k} = \sum \frac{1}{\alpha} + \frac{\sum \frac{d}{\lambda} + M_L + M_b}{\mu}$$

where

- $k$  is the total heat transfer coefficient, in watts per square metre kelvin [W/(m<sup>2</sup>·K)];
- $\alpha$  is the coefficient of heat transfer for surface air, in watts per square metre kelvin [W/(m<sup>2</sup>·K)], as follows:
  - $\alpha = 80$  W/(m<sup>2</sup>·K) for outer surface exposed to wind (20 m/s),
  - $\alpha = 8$  W/(m<sup>2</sup>·K) for inside surface not exposed to wind (0,5 m/s);
- $d$  is the thickness of material, in metres;
- $\lambda$  is the thermal conductivity, in watts per metre kelvin [W/(m·K)];
- $M_L$  is the thermal insulance for an air gap, in square metres kelvin per watt [m<sup>2</sup>·K/W];
- $M_b$  is the thermal insulance between different layers of material, in square metres kelvin per watt [m<sup>2</sup>·K/W];
- $\mu$  is a correction factor for steel structure as follows:
  - $\mu = 1,2$  for insulation in accordance with Figure 3,
  - $\mu = 1,45$  for insulation in accordance with Figure 4.




Figure 3 — Plane insulation of uniform thickness

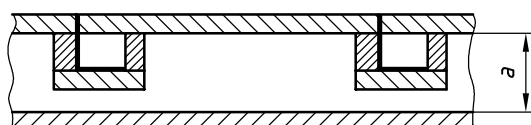


Figure 4 — Corrugated insulation of uniform thickness

Licensed to JAMES ROJAS  
ISO Store order #:862103/Downloaded:2007-11-12  
Single user licence only, copying and networking prohibited

**Table 2 — Total heat transfer coefficient**

Surfaces	Total heat transfer coefficient, kW/(m <sup>2</sup> ·K)
Weather deck not exposed to sun's radiation and ship side and external bulkheads	0,9
Deck and bulkhead against engine-room, cargo space or other non-air-conditioned spaces	0,8
Deck and bulkhead against boiler-room or boiler in engine-room	0,7
Deck against open air or weather deck exposed to sun's radiation and deck against hot tanks	0,6
Side scuttles and rectangular windows, single glazing	6,5
Side scuttles and rectangular windows, double glazing	3,5
Bulkhead against alleyway, non-sound reducing	2,5
Bulkhead against alleyway, sound reducing	0,9

NOTE Guidance on values of thermal conductivities of commonly used materials is given in annex B.

For thermal insulance,  $M_L$ , of non-ventilated air gaps, see Table 3.

**Table 3 — Thermal insulance of non-ventilated air gap**

Boundary surfaces of air gap	Air gap thickness, $a^a$ mm	Thermal insulance $b^b$ m <sup>2</sup> ·K/W
Both surfaces having high emissivity	5	0,11
	20	0,15
	200	0,16
One surface having high emissivity, other surface low emissivity	5	0,17
	20	0,43
	200	0,47
Both surfaces having low emissivity	5	0,18
	20	0,47
	200	0,51
High emissivity surfaces in contact $c^c$	0	0,9

a See Figures 3 and 4

b The term "thermal insulance" is used according to the definition given in ISO 31-4. In many countries this term is known as "thermal resistance" with a symbol  $R$ .

c Aluminium foil and other polished surfaces are assumed to have low emissivity (0,2). All other surfaces are assumed to have high emissivity (0,9).

**5.2.5 Measurement of transmission areas**

The transmission areas for bulkheads, decks and ship sides shall be measured from steel to steel.

### 5.3 Solar heat gain

Solar heat gain,  $\Phi_s$ , is calculated, in watts, as follows:

$$\Phi_s = \sum A_v K \Delta T_r + \sum A_g G_s$$

where

$A_v$  is the surface exposed to solar radiation in square metres (side scuttles and rectangular windows are not included);

$k$  is the total heat transfer coefficient in accordance with 5.2.3 or 5.2.4 for a ship structure (deck, outer bulkhead, etc.) within the surface  $A_v$ ;

$\Delta T_r$  is the excess temperature (above the outside temperature of + 35 °C) caused by solar radiation on surfaces as follows:

$\Delta T_r = 12$  K for vertical light surfaces,

$\Delta T_r = 29$  K for vertical dark surfaces,

$\Delta T_r = 16$  K for horizontal light surfaces,

$\Delta T_r = 32$  K for horizontal dark surfaces;

$A_g$  is the glass surfaces (clear opening) exposed to solar radiation, in square metres;

$G_s$  is the heat gain per square metre from glass surfaces as follows:

$G_s = 350$  W/m<sup>2</sup> for clear glass surfaces,

$G_s = 240$  W/m<sup>2</sup> for clear glass surfaces with interior shading.

For corner cabins, the surface which gives the highest  $\Phi_s$  shall be chosen for calculation of the heat gain.

Surfaces not included in  $A_v$ , because of shadow from overhanging deck or other means of sun protection, shall be calculated at a sun angle of 45°.

NOTE 1 If solar radiation reflecting glass is used,  $G_s$  may be reduced.

NOTE 2 The excess temperatures for vertical and horizontal surfaces and the additional heat gain from glass surfaces caused by solar radiation are based on the most extreme average temperatures in subtropical climate and give the "worst-condition" occurring during a day.

### 5.4 Heat gain from persons

Values of sensible and latent heat emitted by a person at an indoor temperature of 27 °C are given in Table 4.

**Table 4 — Body activity and heat emission**

Activity	Type of heat	Emission W
Seat at rest	Sensible heat	70
	Latent heat	50
Medium/heavy work	Sensible heat	85
	Latent heat	150

Licensed to JAMES ROJAS  
 ISO Store order #:862103/Downloaded:2007-11-12  
 Single user licence only, copying and networking prohibited

**5.5 Heat gain from lighting and other sources**

In spaces with daylight, additional heat gain from lighting shall be ignored.

In spaces without daylight, the heat gain from lighting shall be calculated from the rated wattage of the lighting, as advised by the purchaser or as specified by the appropriate authority. Where the rated output is not specified by the purchaser or the appropriate authority, the heat gain from general lighting shall be taken as stated in Table 5, with consideration given to special lighting requirements.

**Table 5 — Heat gain from general lighting**

Space	Heat gain from general lighting W/m <sup>2</sup>	
	Incandescent	Fluorescent
Cabins, etc.	15	8
Mess- or dining-rooms	20	10
Gymnasiums, etc.	40	20

Refrigerator output shall be taken as 0,3 W/l storage capacity, unless otherwise specified by the purchaser.

Other sources of heat gain, such as from appliances that are in operation for considerable periods during the day, shall only be taken into consideration if specified by the purchaser.

Temporary electrical appliances, such as radio and television sets, hot water urns, etc., shall be ignored.

The heat gain from equipment, etc. in the radio cabin shall be taken as 2,5 kW, unless otherwise specified by the purchaser.

Heat gain from fans shall be taken to give a rise in the temperature of the air of 1 °C/kPa pressure rise.

The rise in the temperature of the air in ducts shall be limited to + 2 °C.

**6 Airflow calculation**

**6.1 Volume of space**

The volume of furniture, wardrobes, stationary equipment, etc. shall not be deducted in calculating the gross volume of cabins and other spaces.

**6.2 Supply airflow**

**6.2.1 Air supply for air-conditioning**

The air supply to each air-conditioned space shall be calculated using whichever of the following criteria gives the highest value:

- a) airflow to maintain the conditions of 4.2;
- b) airflow to maintain the conditions of 4.3;
- c) outdoor supply airflow not less than 0,008 m<sup>3</sup>/s per person for which the space is designed.

The air supply to cabins with a private sanitary room (bath, shower or W.C.) shall be at least 10 % higher than the exhaust air from the sanitary.

NOTE It is to be observed that there are national regulations specifying a minimum number of air changes.

ISO Store order #:862103/Downloaded:2007-11-12  
Single user licence only, copying and networking prohibited

### 6.2.2 Air supply for ventilation

Supply of conditioned air to ventilated spaces, such as those listed below in a) to e), shall be provided directly or by transfer of less vitiated air from an adjacent space, and shall be sufficient to permit the exhaust airflow requirements of 6.4 to be met:

- a) public sanitary rooms (bath, shower, urinal or W.C.);
- b) laundry;
- c) drying-and ironing-rooms;
- d) changing-rooms;
- e) cleaning-lockers.

NOTE It is assumed that supplementary means of heating are provided for ventilated spaces where necessary.

### 6.3 Temperature of supply airflow

The temperature of the air supplied to the space shall not be more than 10 °C lower than the average temperature nor, for the heating mode, more than 23 °C higher than the average temperature of the space.

### 6.4 Exhaust airflow

#### 6.4.1 Volume of airflow

The exhaust airflow in saloons, mess- and dining-rooms and common day-rooms shall be the same as the supply airflow.

The exhaust airflow in hospitals and pantries shall be at least 20 % more than the supply airflow.

The exhaust airflow in private sanitary rooms (bath, shower or W.C.) shall be 0,02 m<sup>3</sup>/s or a minimum of 10 air changes per hour, whichever gives the highest value.

The exhaust airflow in common sanitary rooms (baths, show, urinal or W.C.), laundries and drying- and ironing-rooms shall be a minimum of 15 air changes per hour and in changing-rooms, washrooms and cleaning-lockers a minimum of 10 air changes per hour.

Public sanitary rooms in passenger ships, including ferries, shall be given special consideration. The exhaust airflow shall be a minimum of 15 air changes per hour or the volume calculated from 0,3 m<sup>3</sup>/s, whichever gives the highest volume.

#### 6.4.2 Exhaust system

The exhaust system from the spaces listed below in a) and b) shall be fed directly to the open air, and not used for recirculation. Additionally, the exhaust systems for each of these spaces or group of spaces shall be separate from each other:

- a) hospitals;
- b) sanitary rooms, laundry, pantry, etc.

### 6.5 Air balance

The system shall be positively balanced. It shall be applicable on every deck.

In rooms where there is one tumbler dryers or more, the balance between supply and exhaust air shall be taken into account in consultation with the manufacturer.

Hospitals and pantries shall be maintained at a slightly lower pressure than that in the adjoining accommodation.

Licensed to JAMES RÓJAS  
ISO Store order #:862103/Downloaded:2007-11-12  
Single user licence only, copying and networking prohibited

## **Annex A** (informative)

# **Guidance and good practice in the design of ventilation and air-conditioning systems in ships**

### **A.1 System and ducting**

The layout of the plant and duct sizes should allow air supply without recirculation.

### **A.2 Supply air**

In hospitals, a non-return flap should be installed in the supply air duct.

### **A.3 Exhaust air**

In laundries and drying-and ironing-rooms, exhaust air devices should be installed over areas with high heat emission and high humidity.

### **A.4 Air movement in the occupied areas**

The air movement in the occupied areas should be within limits shown in Figure A.1.

Air velocity for the upper value is applicable only in spaces where people are active.

NOTE For normal applications for human comfort, the occupied areas are geometrically limited to 0,15 m from all room surfaces with a height of 1,80 m above the floor.

### **A.5 Temperature variation in the occupied areas**

The maximum difference in temperature between any points within the occupied areas (see A.4) should not exceed 2 °K.

### **A.6 Refrigerating machinery**


For a seawater system, the size of the condenser should be based on an inlet water temperature of + 32 °C. For systems up to 7,5 kW, the compressor motor selected should be the next size up for worldwide application.

For systems larger than 7,5 kW, the compressor motor should be capable of driving the compressor at an inlet water temperature of + 35 °C or, alternatively, have a fixed overload capacity in percentage corresponding to an inlet water temperature increase from 32 °C to 35 °C and some commonly occurring evaporation temperature.

For an indirect cooling system, the condenser should be designed for + 36 °C on inlet cooling water and the compressor motor for + 38 °C.

When calculating the total heat transfer of the condenser, a fouling factor of 0,000 09 m<sup>2</sup>·K/W should be used. The fouling factor for a closed chilled water system should be half the seawater fouling factor in a condenser.

When calculating the cooling effect, a specific mass of air of 1,20 kg/m<sup>3</sup> should be used.

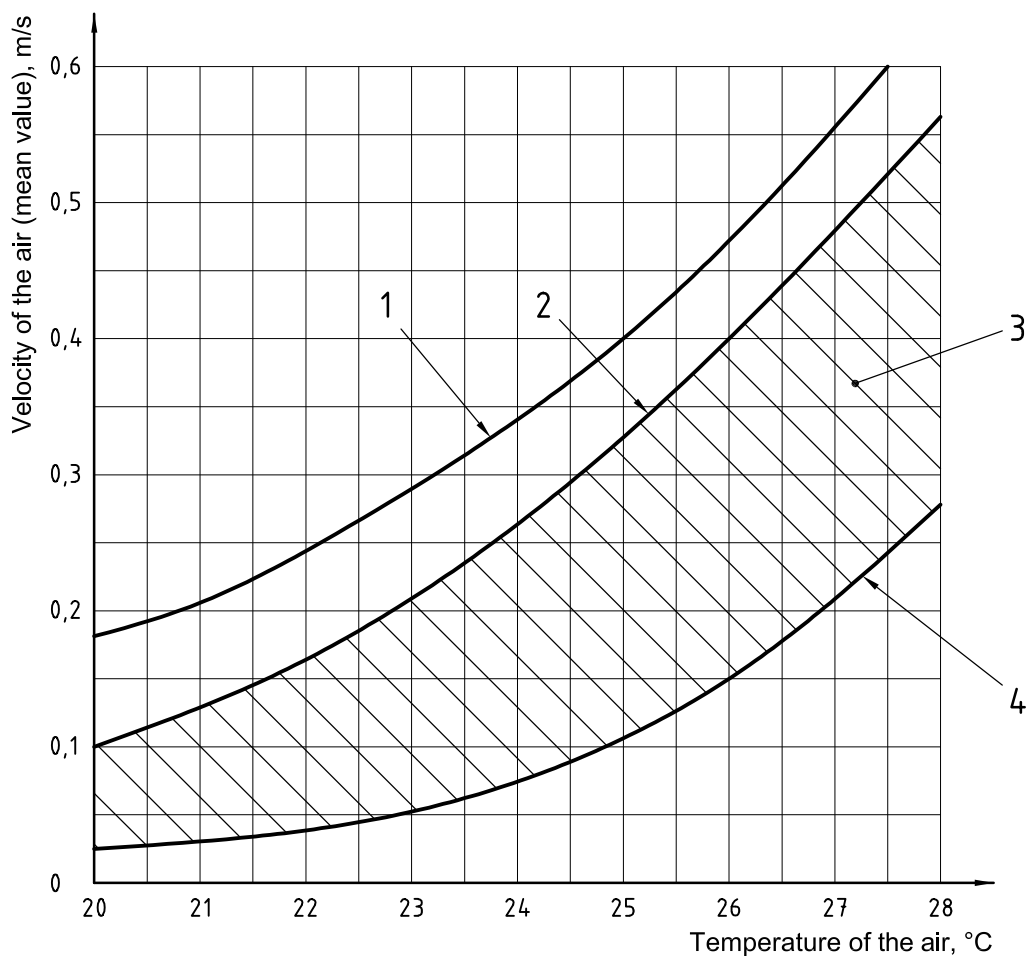

#### Key

- |               |                       |
|---------------|-----------------------|
| 1 Upper value | 3 Comfortable climate |
| 2 Mean value  | 4 Lower value         |

**Figure A.1 — Air movement in occupied areas**

## A.7 Sound

The system should be so designed that the A-weighted sound pressure level from the air distributing system measured 1 m from the air terminal device should not exceed 55 dB (A).

## A.8 Temperature control

Individual temperature control should be fitted to each accommodation space. This can be obtained in a number of ways such as controlling the airflow, thermoexpansion valves, three-way regulating valves, solenoids and others.

## A.9 Humidification during winter

With humidification during the winter, it is strongly recommended that the upper level of humidification be limited to 35 % relative humidity and that the humidification be so controlled that it only takes place during long periods of cold and dry weather. The risk of condensation on cold surfaces and thereby the risk of formation of ice in the

insulation should be taken into consideration. Where insulation is fitted on surfaces exposed to the atmosphere, care should be taken to ensure a complete vapour seal, to avoid penetration of warm humid air.

### **A.10 Use of process steam from boilers**

Process steam from boilers should not be used for humidification. Such steam has quantities of chemical substances and may change the smell of air and increase the number of positive ions in air.



## Annex B (informative)

### Thermal conductivities of commonly used construction materials

Material	Specific mass of dry material Kg/m <sup>3</sup>	Practical value of thermal conductivity, $\lambda$ , at normal moisture content W/(m·K)
Aluminium		200
Mild steel		50
Window glass	2 600	0,8
Wood (heatflow at right angles to fibres):		
— fir, pine	500	0,14
— beech, oak	700	0,16
Chipboard	600 400	0,04 0,05
Wood fibre sheets:		
— hard	1 000	0,13
— medium-hard	600	0,06
— soft	300	0,052
Cork sheet (expanded) <sup>a b</sup>	140 210	0,04 0,05
Mineral wool: <sup>a c</sup>		
— fibreglass		
— fibre 6 $\mu$ m	15 to 100	0,04
— fibre 20 $\mu$ m	40 to 200	0,05
— slag wool, rockwood	35 to 200	0,05
Mineral fibre sheet	400	0,06
Floor coverings:		
— carpet and fibrous underlay		0,045
— cork		0,06
— rubber or plastic tile		0,4
— ceramic tile		1,8
<sup>a</sup>	The indicated thermal conductivity only applies where a flow of air that can make an appreciable difference to the insulation cannot arise in the material or flow through it.	
<sup>b</sup>	The thermal conductivity indicated is only valid where no airflow is possible in the joints between the sheets.	
<sup>c</sup>	If the insulation is compressed, the thickness in the compressed state is to be used as the basis for the calculation of the heat transfer coefficient.	

